



**CGS Analysen-
Mess- und
Regeltechnik
GmbH**

Keltenstraße 3
D-85095
Denkendorf
Telefon
08466/9415-0
Telefax
08466/9415-49

Documentation


**ANALYSER EQUIPMENT
ASU No. 9 Kosice
Moisture Probe in Protection Box
QE15043**


**AIR LIQUIDE AGS GmbH
D-47805 Krefeld**

Project-No.:
05/142
Order-No.:
4500025169

revision list




[illegible]

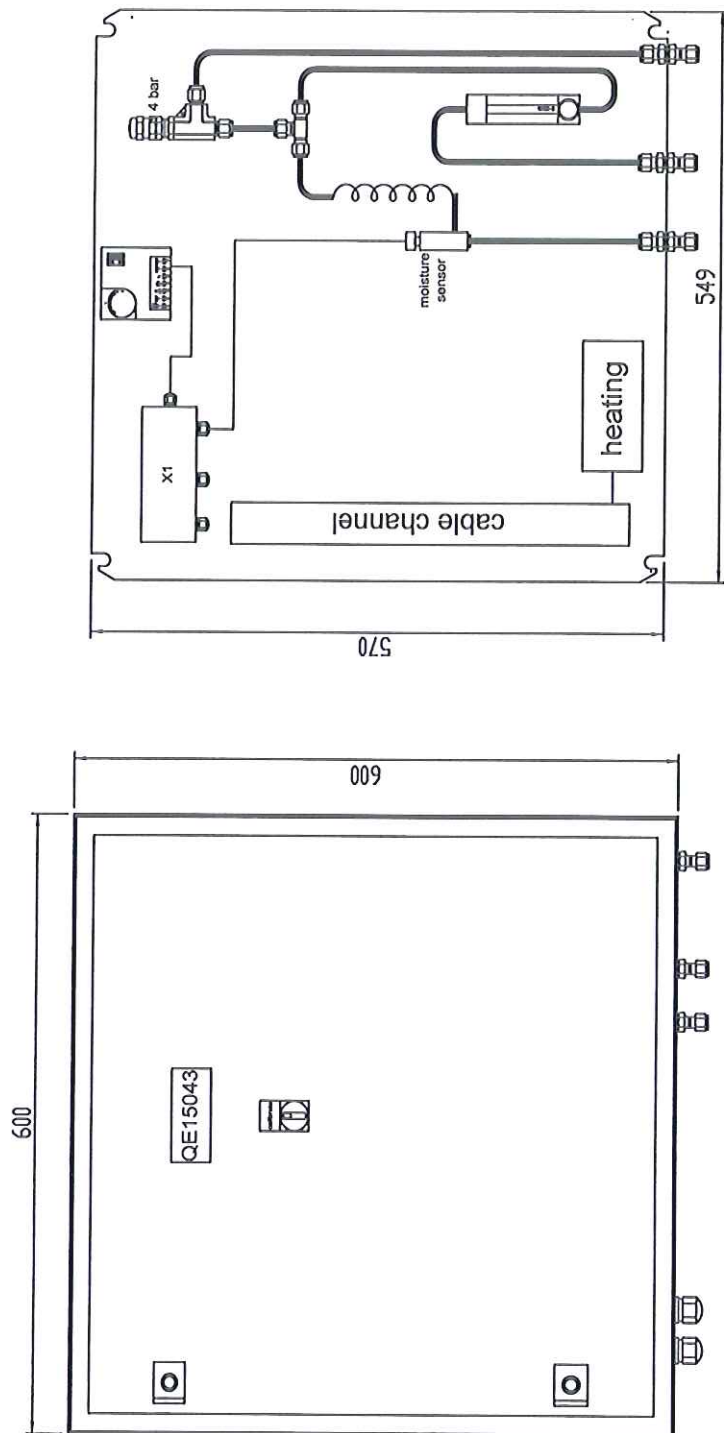
[illegible]

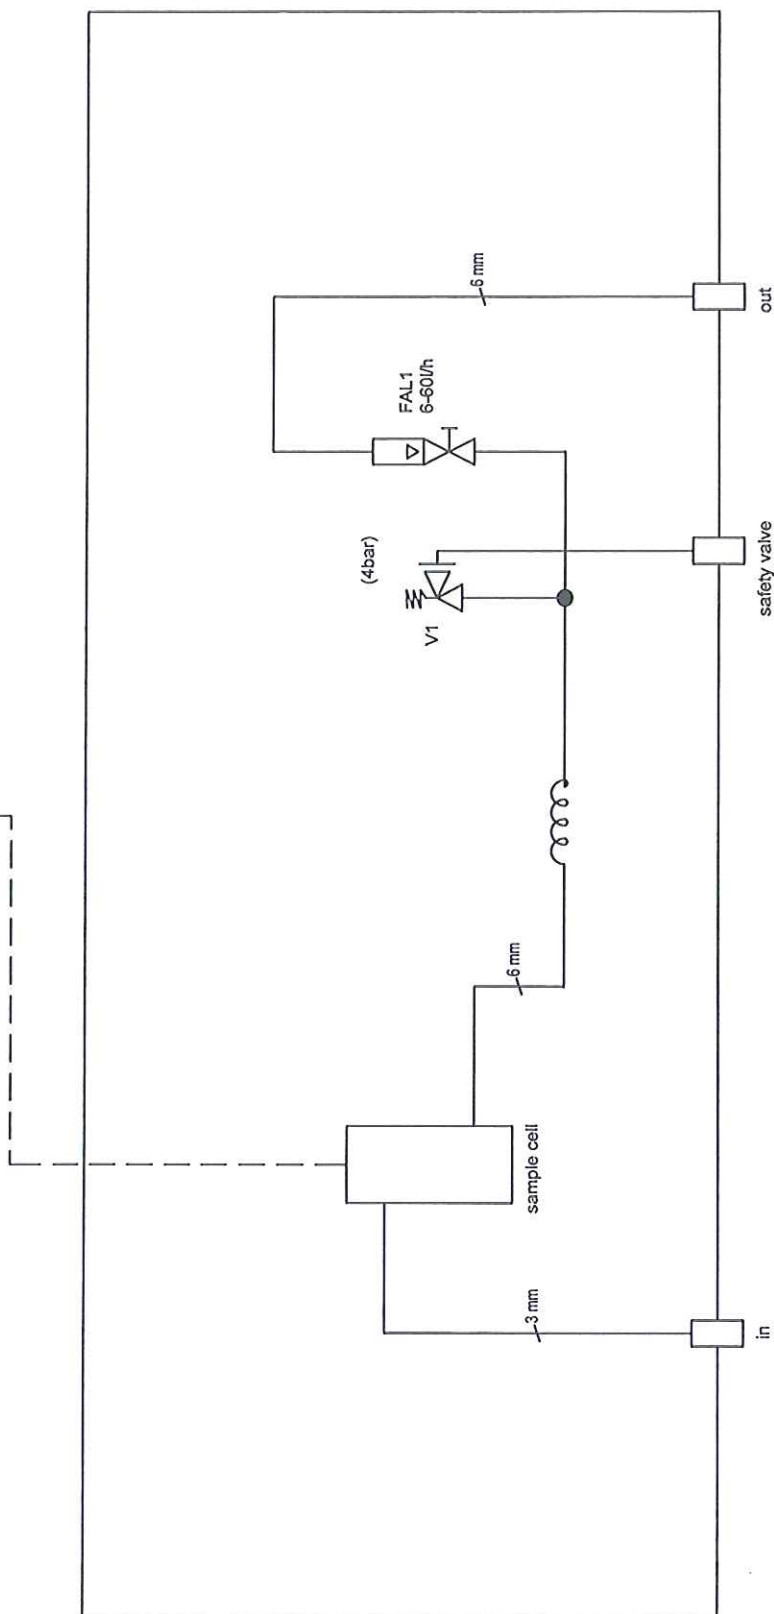[illegible]

11 12 13 14 15 16 17 18

power supply
230 V / 50 Hz

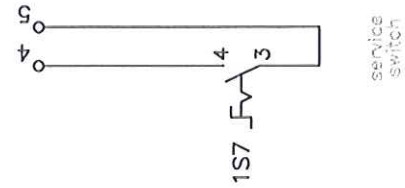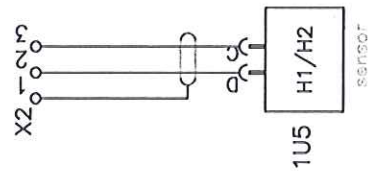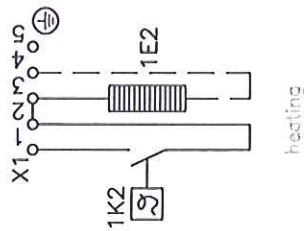

desc	revision	date	name	check	norm	file 05-142 Kosice	Air Liquide AGS GmbH	 Air Liquide	QE15043	project name: ASU Kosice	drawing number	sheet 1

[illegible]

[illegible]