

**Oberflächenbehandlung**  
Surface treatment  
Bühnen, Leitern und Gitterroste:  
platforms, ladders, gratings  
- feuerverzinkt  
- hot dip galvanized

Zeichnung gehört zu  
see also drawing:

Die folgenden technischen Anforderungen sind einzuhalten:  
The following technical requirements are to be fulfilled:

- Allgemeintoleranzen nach DIN ISO 2768 -
- Allgemeintoleranzen für Schweißkonstruktionen nach EN ISO 13970 - CG
- Schweißnahtvorbereitung nach DIN 8551 T1 und T4.
- Tragende und gasbeaufschlagte Schweißnähte sind 100% visuell zu prüfen.


- General Tolerances in accordance with DIN ISO 2768 - C
- EN ISO 13920 - CG
- Preparation of welds in accordance with DIN 8551 part 1 and part 4.
- Supporting and gas-primed welds are checked 100% visual.
- All welds without dimensions: a = 4mm

ARCHIVES REV. NO.	REV.	JOB NO.	DESCRIPTION	SIGN.	DATE


## REVISIONS




Air Liquide AGS GmbH

	DATE:	18.04.05	NAME:	Speyer	CHECKED:	Eisel	INVENTORY FILE:	95-90-504-146g
	JOB CODE:		K70101 ASU No. 9		SCALE:		1:101(20)	
REFERENCE:		TITLE:		COLDBOX-STAGES and ladders		SHEET 1		REV. 0
				platform + 53.7 m / +48.4 m		DRAWING NO. 95-101-503		

Ansicht/view S

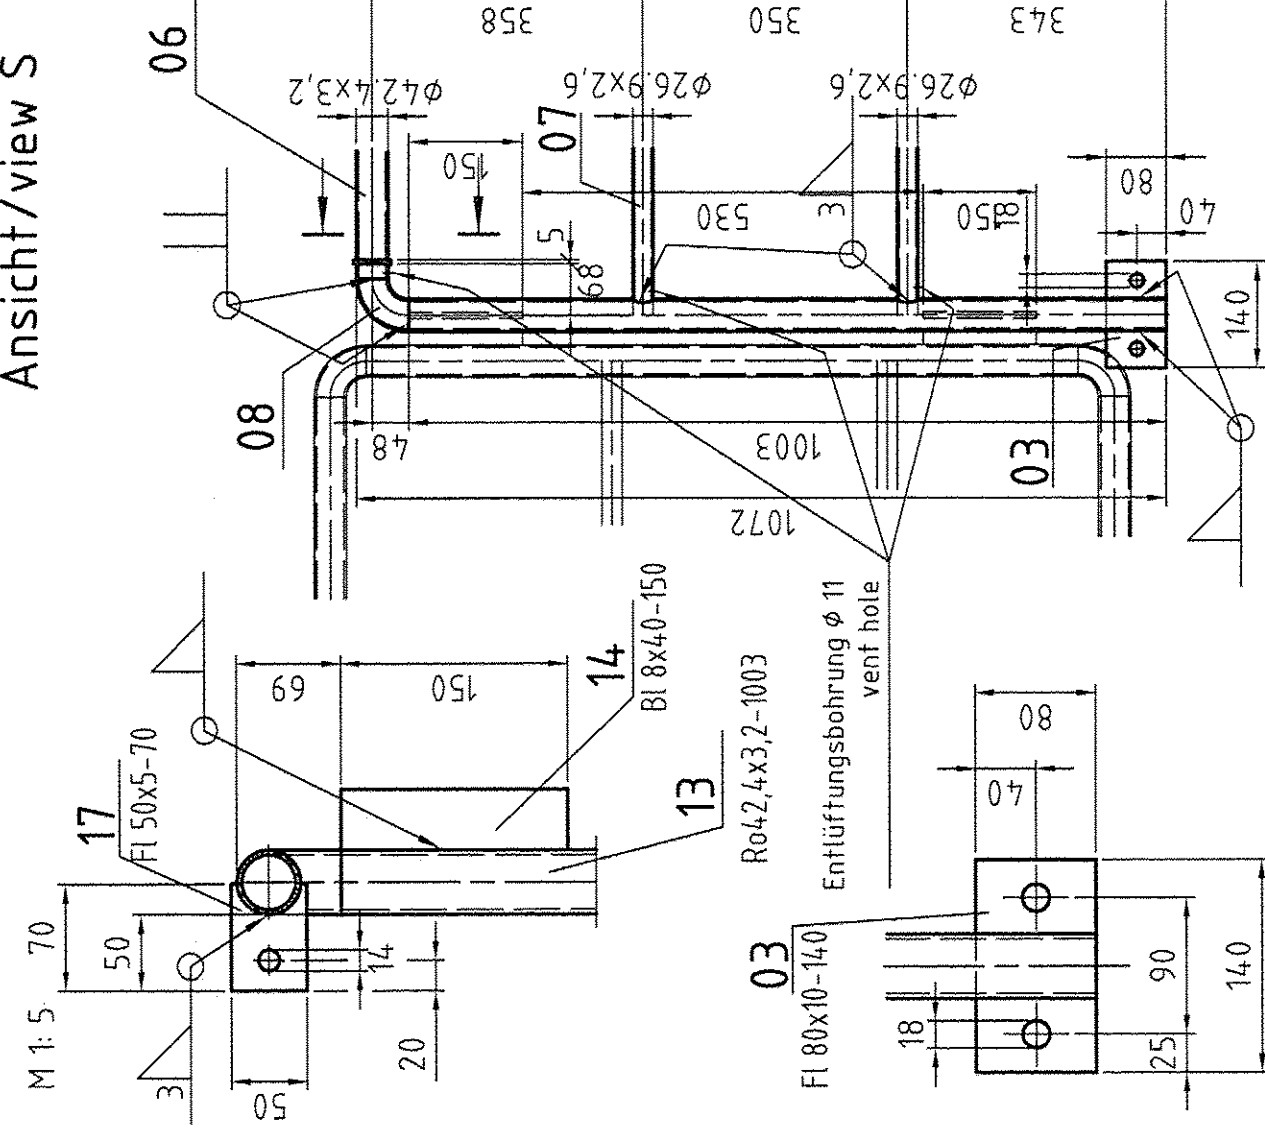

Ansicht/view R

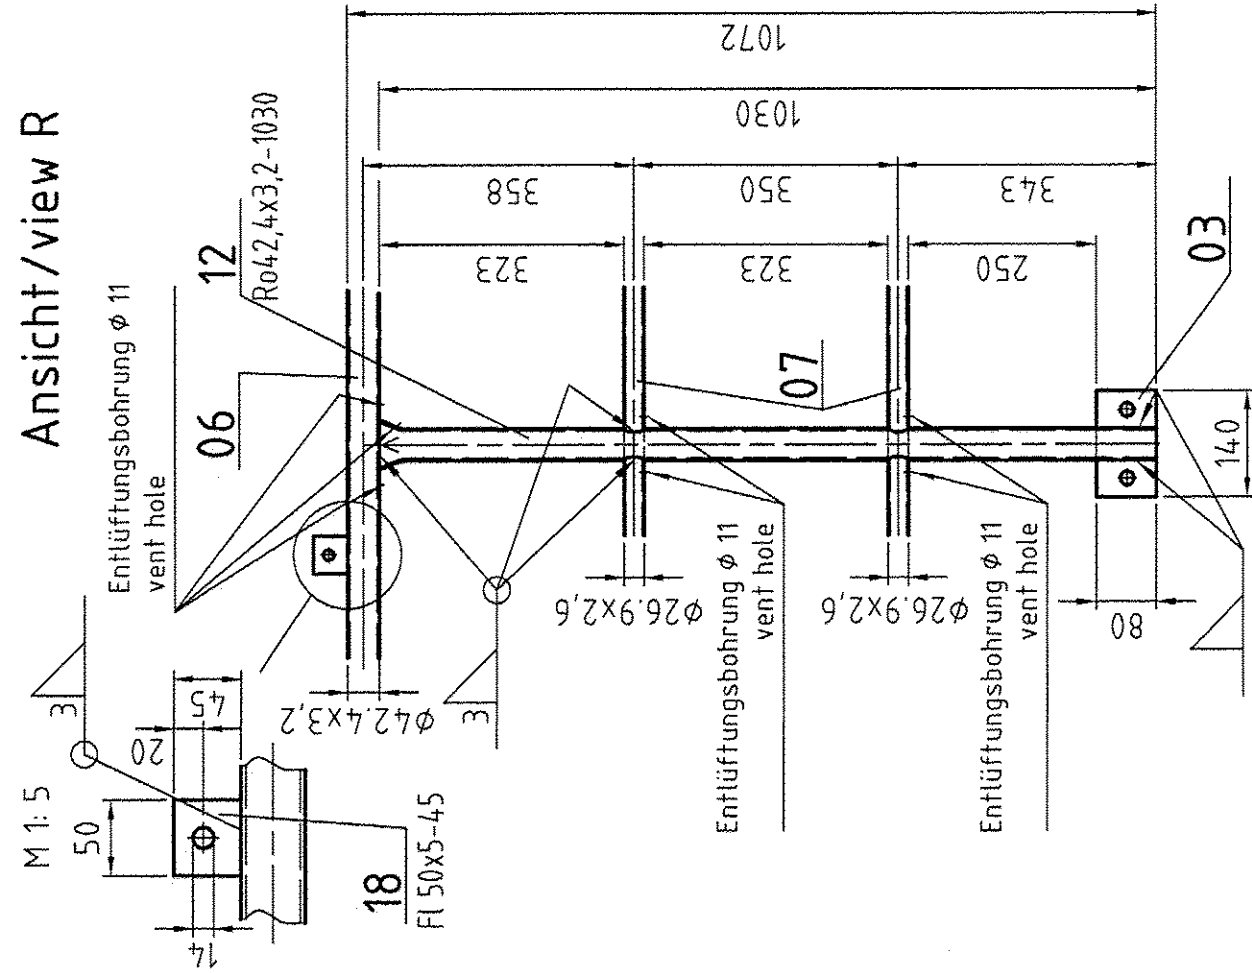

Ansicht/view T

