
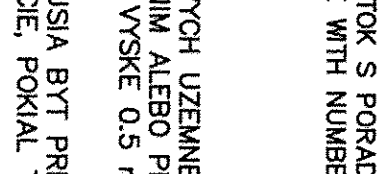


ZEMNIAŽE VEDENIE ULOŽENÉ V ZEMI
 EARTHING CABLE PLACED IN GROUND
 TPŮVE SVORKY SS, SK, SP 1, ... (NA POUZITÍ)
 TYPE CLAMPS SS, SK, SP 1, ... (above ground)
 ZVÁR ZEMNIAŽICH VEDENÍ (V ZEMI)
 CONNECTIONS OF EARTHING CABLES – (WELDS UNDER GROUND)
 SKUSOBNA SVORKA SZ
 TEST CLAMP SZ
 OCHRANNÝ UHOLNÍK OU S PODPERAMI DUZ
 SAFETY ANGLE OU WITH SUPPORTS DUZ
 POPISNÝ STŮP S PORADYM ČÍSLOM
 INDEX PLATE WITH NUMBERING

POZNÁMKA:
 PRÍPOJENIE PÁSKOVÝCH UZEMNENÍ NA OCELOVE STUPY
 SA UROBÍ PRIVARENÍM ALEBO PRISKRUŽKOVANÍM MOSADZNOU
 SKRUTKOU M10 VO VÝŠKE 0,5 m NAD PATKAMI ČEZ SKUSOBNE
 SVORKY.
 NA BLESKOVOD MUSIA BYŤ PRÍPOJENÉ VŠETKY
 KOVOVÉ KONSTRUKČIE, POKIAĽ TIETO NIE SÚ S NIMI
 VODIVOVO SPOJENÉ.
NOTICE:
 CONNECTION OF EARTHING STRIPES WITH COLUMNS TO BE MADE
 BY WELDING OR BRASS BOLT M10 ELEVATION 0,5 m UP ON FOUNDATIONS
 THROUGH TEST CLAMP
 EVERY STEEL STRUCTURES HAVE TO BE CONNECTED WITH CONDUCTOR
 IF THEY ARE NOT CONDUCTIVE CONNECTED
 CONNECTION FROM COLUMN TO COLUMN 1m DEEP
 MATERIAL: Fezn 30x4 mm

±0,000=225,150m.n.m
 SPRACOVANÉ POD ZNAČKOVÝM ČÍSLOM:156/2004/SO/



			
Date : 21.03.2006	Name : ING.DURĽA	Checked:	ZERN UZEMNENIA
Job code: 06/ 2005	Reference: ASU No.9 KOŠICE	History file:	
Title: KÁBELOVÝ MOST /CABLE_ BRIDGE UZEMNENIE /EARTHING STUPOV /LAOUT		Scale 1:100,20	Original format DIN A2
Drawing No.: 792.88023		Sheet: 1 of 1	Rev. A